

OPERATION


The H909 is a current-sensitive switching device that monitors current (amperage) in the conductor passing through it. A change in amperage in the monitored conductor that crosses the switch (setpoint) threshold plus the hysteresis value will cause the resistance of the FET status output to change state, similar to the action of a mechanical switch. In this model, the setpoint is adjustable through the action of a twenty (20) turn potentiometer (see the CALIBRATION section). The status output is suitable for connection to building controllers or other appropriate data acquisition equipment operating at up to 120 volts. The H909 requires no external power supply to generate its output.

The H909 housing offers unprecedented mounting flexibility. The mounting bracket can be attached in three different places. Additionally, the bracket is compatible with the Veris AH01 DIN Rail clip, allowing DIN mounting.

NOTES

For load currents greater than sensor maximum rating:

Use a 5 Amp (H68xx series) Current Transformer (CT) as shown. This technique can be combined with wrapping (see below) when added safety is desired for a low current load on a high current source.

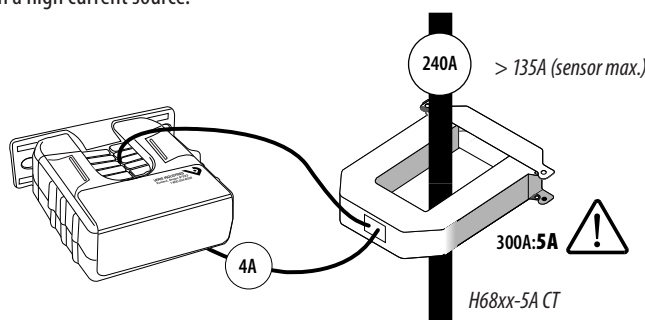

DANGER: 5A CTs can present hazardous voltages. Install CTs in accordance with manufacturer's instructions. Terminate the CT secondary before applying current.

CAUTION

RISK OF EQUIPMENT DAMAGE

- Derate the product's maximum current for the number of turns through the sensing window using the following formula.


Rated Max. Amps ÷ Number of Turns = Max. monitored Amps
e.g.: 100A ÷ 4 Turns = 25 Amps max. in monitored conductor

- Failure to follow these instructions can result in overheating and permanent equipment damage.

For load currents less than sensor minimum rating:


Wrap the monitored conductor through the center hole and around the sensor body to produce multiple turns through the center window. This increases the current measured by the transducer.

Program controller to account for the extra turns. e.g., if four turns pass through the sensor (as shown) divide the normal controller reading by 4.




CALIBRATION

Before beginning calibration, establish normal load conditions.




Then choose either A or B below.

A. To monitor under-current (belt loss, coupling shear, status)

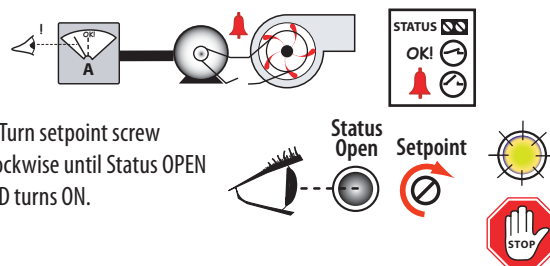


- Turn setpoint screw clockwise until Status OPEN LED turns ON.

- Slowly turn the screw counter-clockwise until the Status CLOSED LED just turns ON.

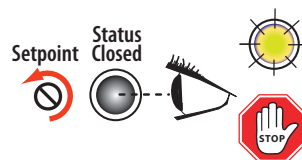


- Turn the screw an additional 1/4 turn counter-clockwise for operational margin.


B. To monitor over-current (mechanical problems, seized impeller)

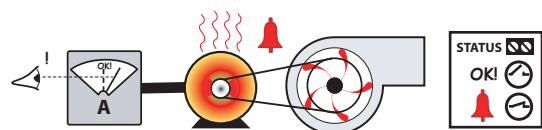

- Turn setpoint screw counter-clockwise until Status CLOSED LED turns ON.

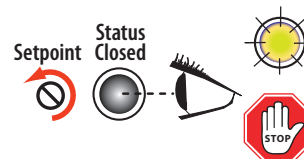

- Slowly turn the setpoint screw clockwise until the Status OPEN LED just turns ON.

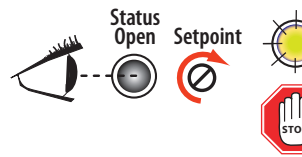

- Turn the setpoint screw an additional 1/4 turn clockwise for operational margin.

TROUBLESHOOTING

Problem	Solution
No Reading at Controller	- Check sensor calibration (see above) - Check for control voltage at sensor (<120V) - Check for amperage in monitored conductor (> 2.5A) - Assure that sensor core mating surfaces are clean and that the core clamp is completely closed
Setpoint screw has no stops	The setpoint screw has a slip-clutch at both ends of its travel to avoid damage. Twenty turns CCW will reset the sensor to be most sensitive. Repeat calibration above.
Both LEDs are lit	Setpoint screw is too far clockwise. See solution above.